


OCD Mechanical Info. - FOR INTERNAL USE ONLY

Designer Who Last Modified File:	Candace Rechsteiner	SPC Number in OTIS:	SPC54484	12-10-15 CR used 701-80-016-1 with revs per marked up PDF for Clonim PH2. Enlarged file to 100% per printer specifications.
Date File Was Last Modified:	12-16-15	Dimension on SPC:	4.38" x 3.1/2" x 1.1/4"	12-16-15 CR made rev per KD review
2nd Designer review:	12-17-15 KD	Line Screen:	None	12-17-15 KD signed.
PMS Colors Used in File:	Black		PMS 288	
			PMS 185	
			Non Varnish	

701-80-016-1
Red Cells Carton
France

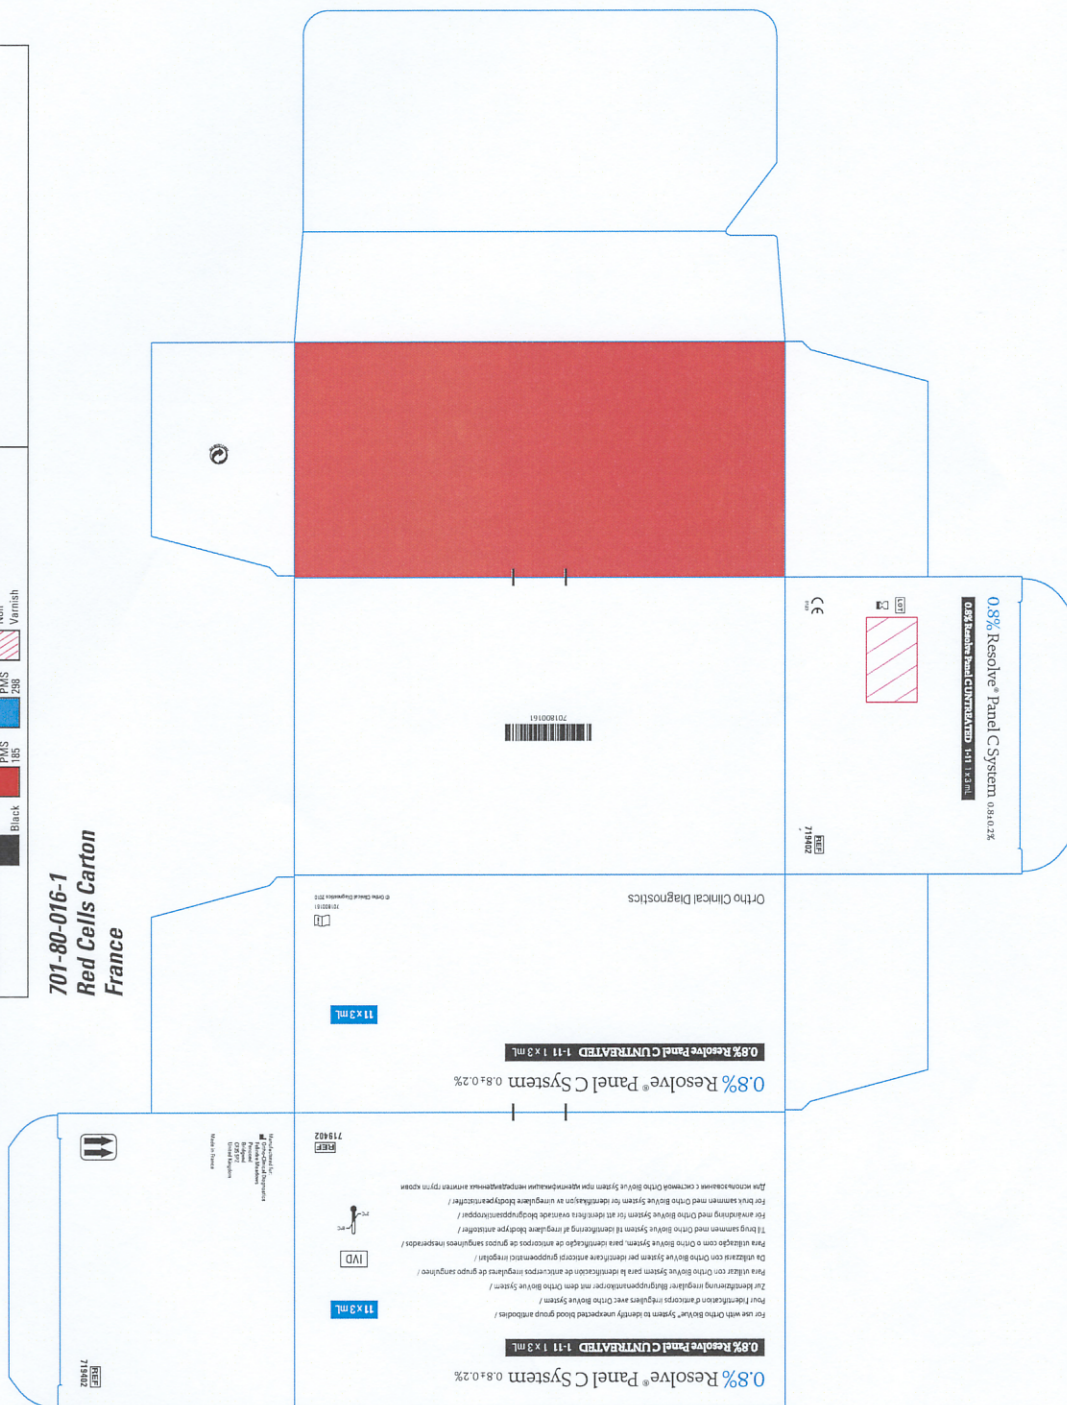

Ortho Clinical Diagnostics
Pencoed, UK

12th Oct 2017


Ortho Clinical Diagnostics
Pencoed, UK

7/02 12:02 21/01/2017

OCD Mechanical Info. - FOR INTERNAL USE ONLY

Designer Who Last Modified File:	Candace Reckstetter	SPC Number in OTIS:	SPC54571	12-10-15 CR used 701-80-018-1 (CRMU) to create 701-80-018-1 with revs on marked up PDF for Cinscan PH2. Enlarged carton to 100% per printers specifications.
Date File Was Last Modified:	12-16-15	Dimension on SPC:	8.78" x 3.916" x 7.38"	12-16-15 CR made rev per KD review
2nd Designer review:	12-17-15	Line Screen:	None	12-17-15 KD signed.
PMS Colors Used in File:	Black	PMS 298	Non	
		PMS 185	Varnish	

701-80-018-1
Red Cells Carton
France

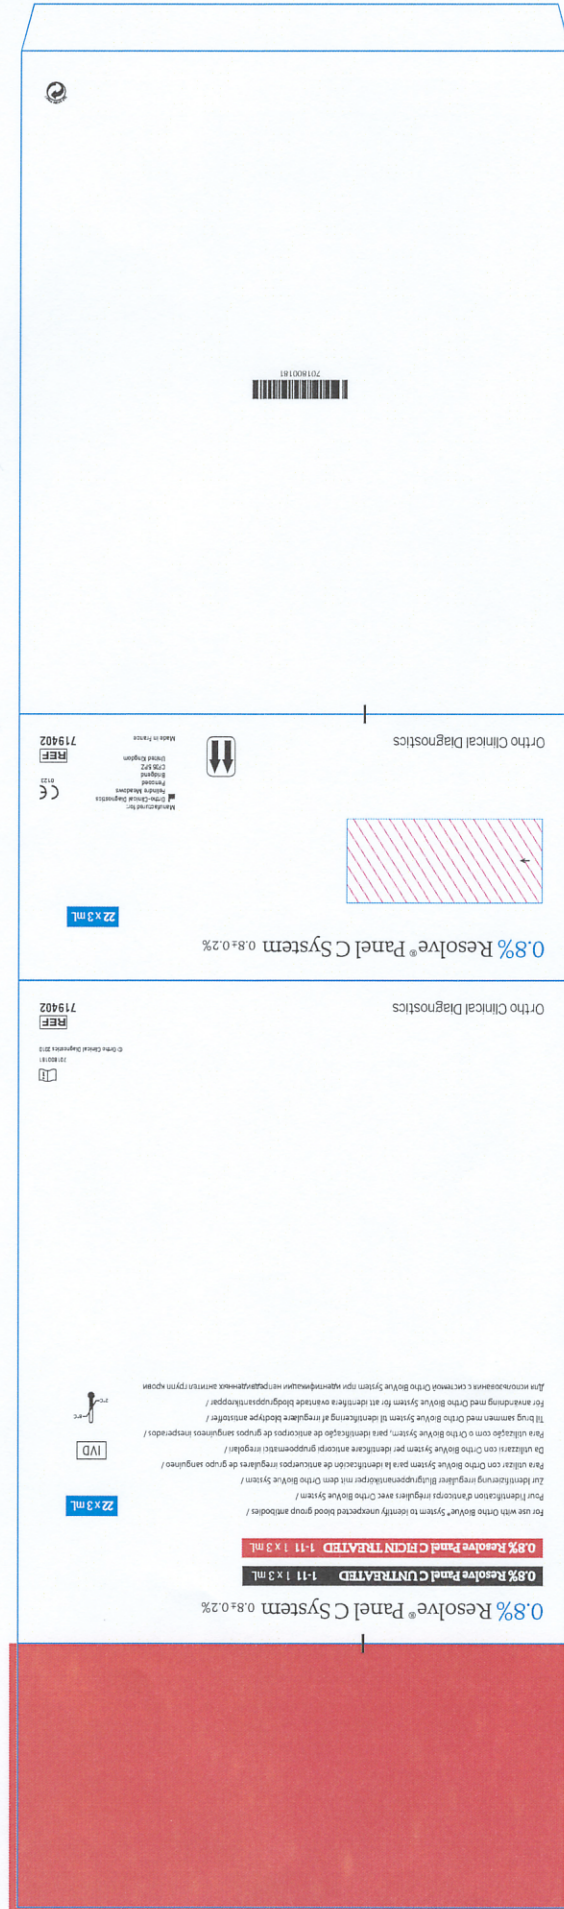

OCD Mechanical Info. – FOR INTERNAL USE ONLY


Designer Who Last Modified File:	<i>Candace Rechsteiner</i>	SPC Number in OTIS:	SPC54764	01-28-16 CR used 601-80-034-1CRMU and made changes per marked up PDF for Crimson PH2. 01-29-16 KT signed.
Date File Was Last Modified:	01-28-16	Dimension on SPC:	2" x 7/8"	
2nd Designer review: (layout and requested changes only)	01-29-16 KT	Line Screen:	30% PMS 185 using 85 line screen	
PMS Colors Used in File:	Black		PMS 298	

601-80-169-1

Red Cells Vial Label

Done 12th Oct 2017

Ortho Clinical Diagnostics
Pencoed, UK




OCD Mechanical Info. – FOR INTERNAL USE ONLY

Designer Who Last Modified File:	Candace Rechsteiner	SPC Number in OTIS:	SPC54770	01-28-16 CR used 601-80-035-1CRMU and made changes per marked up PDF for Crimson PH2. 01-29-16 KT signed.
Date File Was Last Modified:	01-28-16	Dimension on SPC:	2" x 7/8"	
2nd Designer review: (layout and requested changes only)	01-29-16 KT	Line Screen:	30% PMS 185 using 85 line screen	
PMS Colors Used in File:	Black	PMS 185	PMS 298	

601-80-170-1

Red Cells Vial Label




12th Oct 2017
 Ortho Clinical Diagnostics
 Pencoed, UK

OCD Mechanical Info. – FOR INTERNAL USE ONLY

Designer Who Last Modified File:	Candace Rechsteiner	SPC Number in OTIS:	SPC54771	01-28-16 CR used 601-80-036-1CRMU and made changes per marked up PDF for Crimson PH2. 01-29-16 KT signed.
Date File Was Last Modified:	01-28-16	Dimension on SPC:	2" x 7/8"	
2nd Designer review: (layout and requested changes only)	01-29-16 KT	Line Screen:	30% PMS 185 using 85 line screen	
PMS Colors Used in File:	Black	PMS 185	PMS 298	

601-80-171-1

Red Cells Vial Label




Ortho Clinical Diagnostics
Pencoed, UK

12th Oct 2017

OCD Mechanical Info. – FOR INTERNAL USE ONLY

Designer Who Last Modified File:	Candace Rechsteiner	SPC Number in OTIS:	SPC54772	01-28-26 CR used 601-80-037-1CRMU and made changes per marked up PDF for Crimson PH2. 01-29-16 KT signed.
Date File Was Last Modified:	01-28-16	Dimension on SPC:	2" x 7/8"	
2nd Designer review: (layout and requested changes only)	01-29-16 KT	Line Screen:	30% PMS 185 using 85 line screen	
PMS Colors Used in File:	Black		PMS 298	

601-80-172-1
Red Cells Vial Label



12th Oct 2017


Ortho Clinical Diagnostics
Pencoed, UK

OCD Mechanical Info. – FOR INTERNAL USE ONLY

Designer Who Last Modified File:	Candace Rechsteiner	SPC Number in OTIS:	SPC54773	01-28-16 CR used 601-80-038-1 CRMU and made changes per marked up PDF for Crimson PH2. 01-29-16 KT signed.
Date File Was Last Modified:	01-28-16	Dimension on SPC:	2" x 7/8"	
2nd Designer review: (layout and requested changes only)	01-29-16 KT	Line Screen:	30% PMS 185 using 85 line screen	
PMS Colors Used in File:	Black	PMS 185	PMS 298	

601-80-173-1

Red Cells Vial Label



Robert 12th Oct 2017

Ortho Clinical Diagnostics
Pencoe, UK

OCD Mechanical Info. – FOR INTERNAL USE ONLY

Designer Who Last Modified File:	<i>Candace Rechsteiner</i>	SPC Number in OTIS:	SPC54774	01-28-16 CR used 601-80-039-1CRMU and made changes per marked up PDF for Crimson PH2. 01-29-16 KT signed.
Date File Was Last Modified:	01-28-16	Dimension on SPC:	2" x 7/8"	
2nd Designer review: (layout and requested changes only)	01-29-16 KT	Line Screen:	30% PMS 185 using 85 line screen	
PMS Colors Used in File:	Black		PMS 185	
			PMS 298	

601-80-174-1
Red Cells Vial Label




12th Oct 2017

Ortho Clinical Diagnostics
Pencoed, UK

OCD Mechanical Info. – FOR INTERNAL USE ONLY

Designer Who Last Modified File:	Candace Rechsteiner	SPC Number in OTIS:	SPC54775	01-28-16 CR used 601-80-040-1CRMU and made changes per marked up PDF for Crimson PH2. 01-29-16 KT signed.
Date File Was Last Modified:	1-28-16	Dimension on SPC:	2" x 7/8"	
2nd Designer review: (layout and requested changes only)	01-29-16 KT	Line Screen:	30% PMS 185 using 85 line screen	
PMS Colors Used in File:	Black		PMS 298	

601-80-175-1 Red Cells Vial Label




11/10/16 12th Oct 2017
Ortho Clinical Diagnostics
Pencoe, UK

OCD Mechanical Info. – FOR INTERNAL USE ONLY

Designer Who Last Modified File:	<i>Candace Rechsteiner</i>	SPC Number in OTIS:	<i>SPC54776</i>	01-28-16 CR used 601-80-041-1CRMU and made changes per marked up PDF for Crimson PH2. 01-29-16 KT signed.
Date File Was Last Modified:	<i>01-28-16</i>	Dimension on SPC:	<i>2" x 7/8"</i>	
2nd Designer review: (layout and requested changes only)	<i>01-29-16 KT</i>	Line Screen:	<i>30% PMS 185 using 85 line screen</i>	
PMS Colors Used in File:	Black PMS 185 PMS 298			

**601-80-176-1
Red Cells Vial Label**




Shelley 12th Oct 2017

Ortho Clinical Diagnostics
Pencoed, UK

OCD Mechanical Info. – FOR INTERNAL USE ONLY

Designer Who Last Modified File:	<i>Candace Rechsteiner</i>	SPC Number in OTIS:	SPC54777	01-28-16 CR used 601-80-042-1CRMU and made changes per marked up PDF for Crimson PH2. 01-29-16 KT signed.
Date File Was Last Modified:	01-28-16	Dimension on SPC:	2" x 7/8"	
2nd Designer review: (layout and requested changes only)	01-29-16 KT	Line Screen:	30% PMS 185 using 85 line screen	
PMS Colors Used in File:	Black PMS 185 PMS 298			

601-80-177-1
Red Cells Vial Label



Printed 12th Oct 2017


Ortho Clinical Diagnostics
Pencoed, UK

OCD Mechanical Info. – FOR INTERNAL USE ONLY

Designer Who Last Modified File:	<i>Candace Rechsteiner</i>	SPC Number in OTIS:	SPC54778	01-28-16 CR used 601-80-043-1CRMU and made changes per marked up PDF for Crimson PH2. 01-29-16 KT signed.
Date File Was Last Modified:	01-28-16	Dimension on SPC:	2" x 7/8"	
2nd Designer review: (layout and requested changes only)	01-29-16 KT	Line Screen:	30% PMS 185 using 85 line screen	
PMS Colors Used in File:	Black		PMS 185	
			PMS 298	

601-80-178-1

Red Cells Vial Label




12th Oct 2017

Ortho Clinical Diagnostics
Pencoed, UK

OCD Mechanical Info. – FOR INTERNAL USE ONLY

Designer Who Last Modified File:	Candace Rechsteiner	SPC Number in OTIS:	SPC54779	01-28-16 CR used 601-80-044-1CRMU and made changes per marked up PDF for Crimson PH2. 01-29-16 KT signed.
Date File Was Last Modified:	01-28-16	Dimension on SPC:	2" x 7/8"	
2nd Designer review: (layout and requested changes only)	01-29-16 KT	Line Screen:	30% PMS 185 using 85 line screen	
PMS Colors Used in File:	Black		PMS 238	

601-80-179-1
Red Cells Vial Label

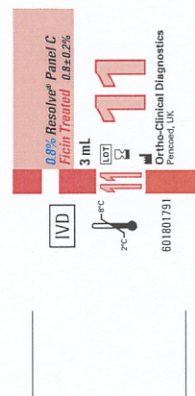

12th Oct 2017

Ortho Clinical Diagnostics
Pencoe, UK