


OCD Mechanical Info. - FOR INTERNAL USE ONLY

Designer Who Last Modified File:	Candace Reichsteiner	SPEC Number in OTIS:	SPC54405	12-16-15 CR used 701-80-017-1 (CHM) in case 701-80-017-1 with one per panel
Date File Was Last Modified:	12-16-15	Dimension on SPC:	4.30" x 3 1/2" x 7 1/4"	12-16-15 CR used 701-80-017-1 (CHM) in case 701-80-017-1 with one per panel
2nd Designer review:	12-17-15 KD	Line Screen:	None	12-16-15 CR used 701-80-017-1 (CHM) in case 701-80-017-1 with one per panel
PMS Colors Used in File:	Black	PMS 185	Non Varnish	12-17-15 KD signed.

701-80-017-1
Red Cells Carton
France

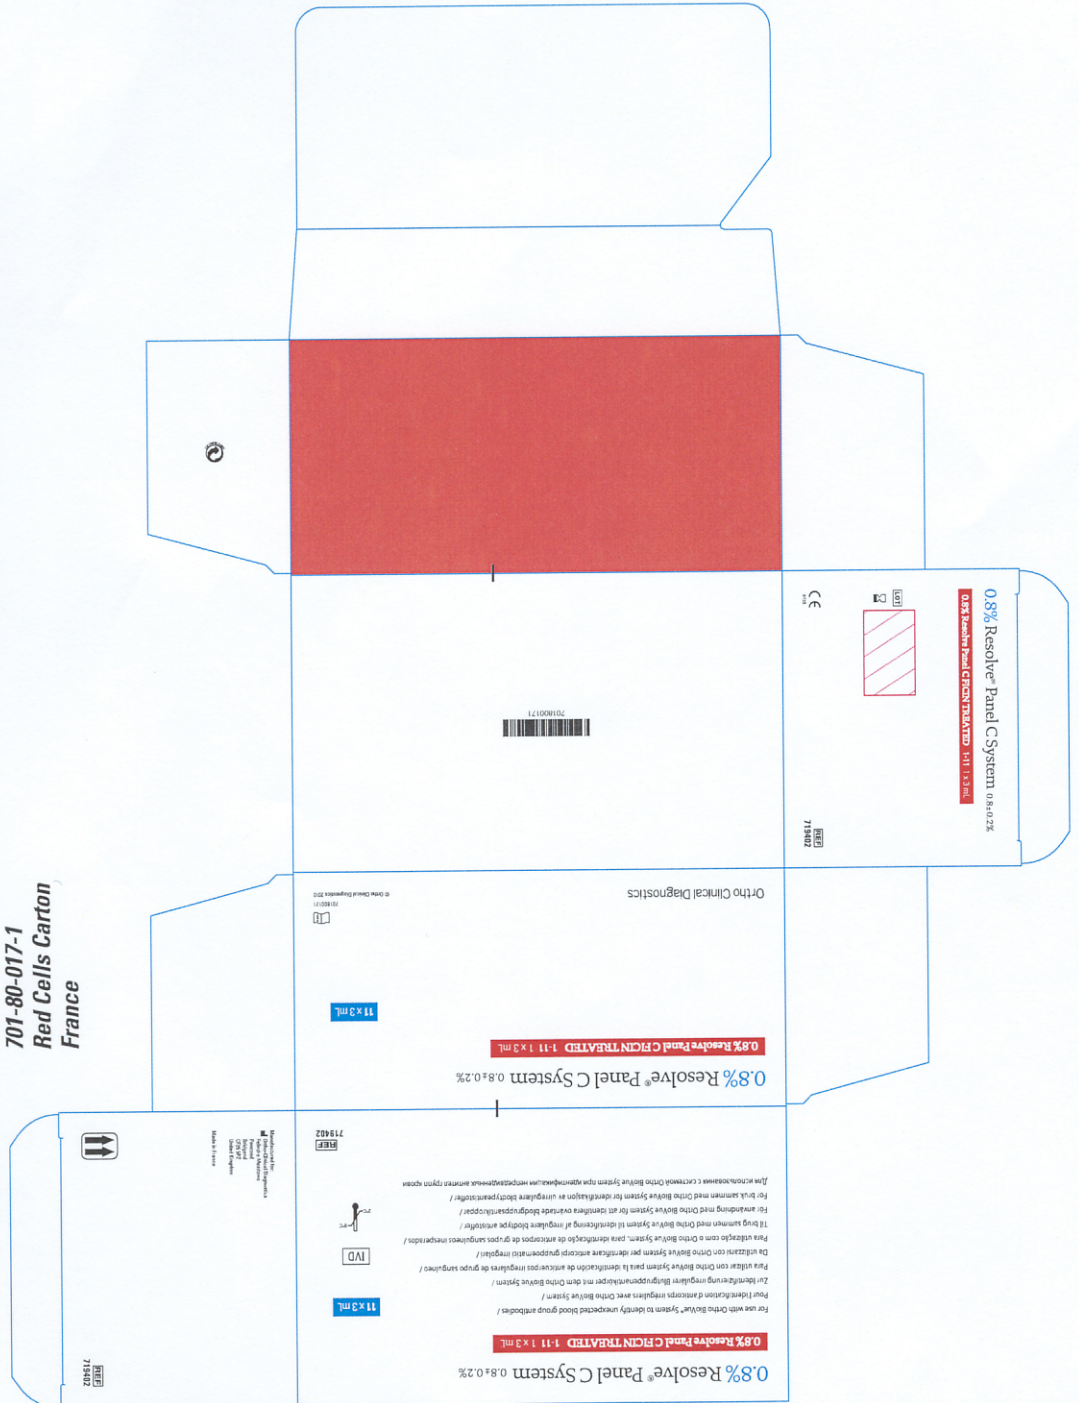

Ortho Clinical Diagnostics
Pencoe, UK


OCD Mechanical Info. – FOR INTERNAL USE ONLY

Designer Who Last Modified File:	Candace Rocheston	SPC Number in OTIS:	SPC5451
Date File Was Last Modified:	12-16-15	Dimension on SPC:	8 7/8" x 3 9/16" x 7 3/8"
2nd Designer review:	12-17-15	Line Screen:	None
PMS Colors Used in File:	Black	PMS 285	Non Vernish

12-10-15 CR used 701-80-018-1 (CRMU) to create 701-80-018-1 with revs on marked up
 10/14/15 for design 701-80-018-1 and cannot to 100% per printers specifications.
 12-16-15 CR used 701-80-018-1 for review
 12-17-15: KD signed.

701-80-018-1
 Red Cells Carton
 France

Ortho Clinical Diagnostics
 Pencoed, UK

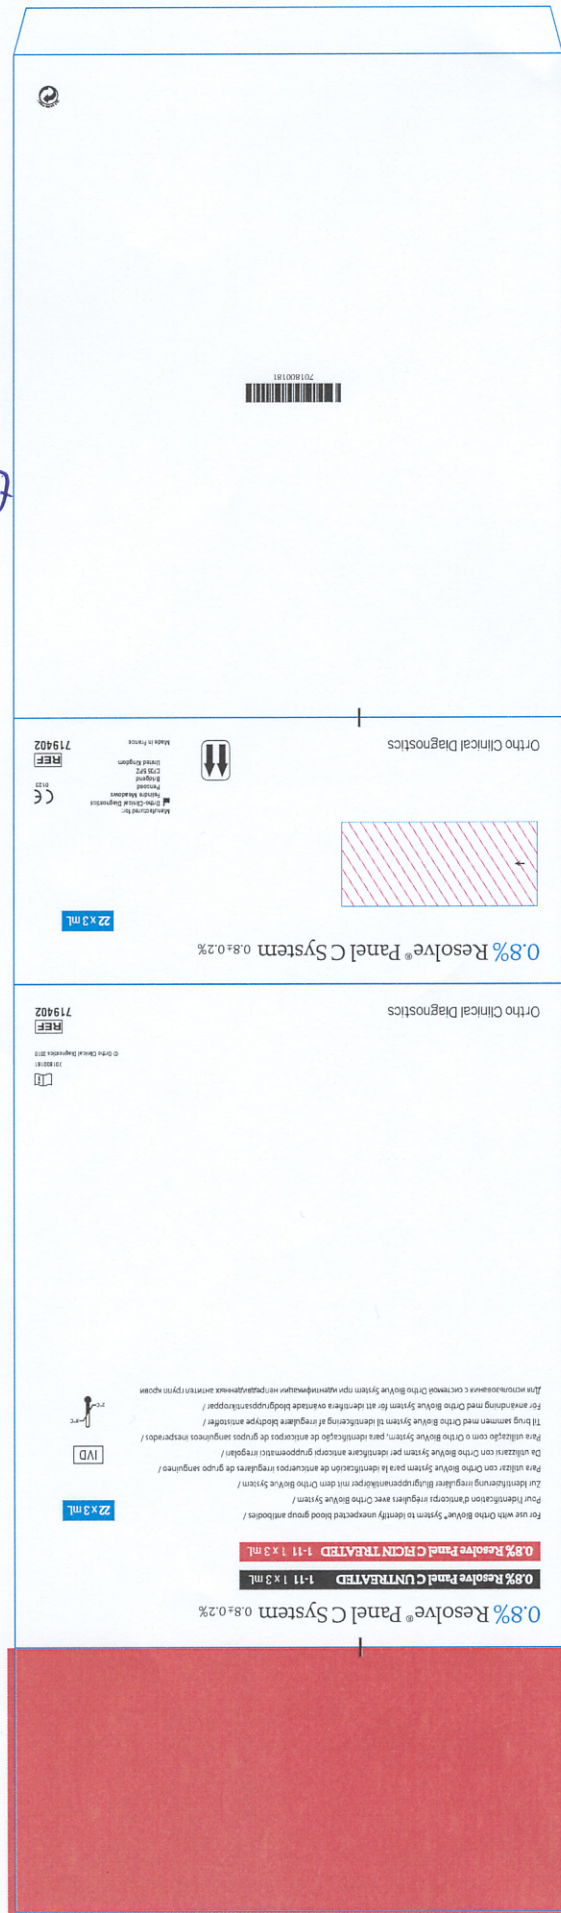


OCD Mechanical Info. – FOR INTERNAL USE ONLY

Designer Who Last Modified File: <i>Candace Rechsteiner</i>	SPC Number in OTIS: <i>SPC54560</i>	12-08-15 CR used 601-80-023-1CRMU to create 601-80-111-1 with revs per PDF marked for Crimson PH2. 12-09-15 KT signed.	
Date File Was Last Modified: <i>12-08-15</i>	Dimension on SPC: <i>2" x 7/8"</i>		
2nd Designer review: (layout and requested changes only)	Line Screen: <i>20% Black & 30% PMS 185 85 line screen</i>		
PMS Colors Used in File:			
 Black	 PMS 185	 PMS 298	

601-80-111-1
Red Cells Vial Label

Ortho Clinical Diagnostics
Pencoe, UK




12th Oct 2017

OCD Mechanical Info. – FOR INTERNAL USE ONLY

Designer Who Last Modified File:	Candace Rechsteiner	SPC Number in OTIS:	SPC54561	12-08-15 CR used 601-80-024-1CRMU to create 601-80-112-1 with revs per marked up PDF for Crimson PH2. 12-09-15 KT signed.
Date File Was Last Modified:	12-08-15	Dimension on SPC:	2" x 7/8"	
2nd Designer review: (layout and requested changes only)	12-09-15 KT	Line Screen:	20% Black & 30% PMS 185 85 line screen	
PMS Colors Used in File:	Black	PMS 185	PMS 298	

601-80-112-1 Red Cells Vial Label



Steven 12th Oct 2017


Ortho Clinical Diagnostics
Pencoed, UK

OCD Mechanical Info. – FOR INTERNAL USE ONLY

Designer Who Last Modified File:	<i>Candace Rechsteiner</i>	SPC Number in OTIS:	SPC54562	12-08-15 CR used 601-80-025-1CRMU to create 601-80-113-1 with revs per marked up PDF for Crimson PH2. 12-09-15 KT signed.
Date File Was Last Modified:	12-08-15	Dimension on SPC:	2" x 7/8"	
2nd Designer review: (layout and requested changes only)	12-09-15 KT	Line Screen:	20% Black & 30% PMS 185 85 line screen	
PMS Colors Used in File:	Black		PMS 185	
			PMS 298	

601-80-113-1

Red Cells Vial Label




12th Oct 2017

Ortho Clinical Diagnostics
Pencoed, UK

OCD Mechanical Info. – FOR INTERNAL USE ONLY

Designer Who Last Modified File:	Candace Rechsteiner	SPC Number in OTIS:	SPC54563	12-08-15 CR used 601-80-026-1CRMU to created 601-80-114-1 with revs per marked up PDF for Crimson PH2 12-09-15 KT signed.
Date File Was Last Modified:	12-08-15	Dimension on SPC:	2" x 7/8"	
2nd Designer review: (layout and requested changes only)	12-09-15 KT	Line Screen:	20% Black & 30% PMS 185 85 line screen	
PMS Colors Used in File:				
PMS 185 PMS 298 Black				

601-80-114-1 Red Cells Vial Label



Ortho Clinical Diagnostics
Pencoed, UK


12th Oct 2017

OCD Mechanical Info. – FOR INTERNAL USE ONLY

Designer Who Last Modified File:	Candace Rechsteiner	SPC Number in OTIS:	SPC54564	12-08-15 CR used 601-80-027-1CRMU to create 601-80-115-1 with revs per marked up PDF for Crimson PH2 12-09-15 KT signed.
Date File Was Last Modified:	12-08-15	Dimension on SPC:	2" x 7/8"	
2nd Designer review: (layout and requested changes only)	12-09-15 KT	Line Screen:	20% Black & 30% PMS 185 85 line screen	
PMS Colors Used in File:	Black	PMS 185	PMS 298	

601-80-115-1

Red Cells Vial Label



[Signature] 12th Oct 2017


Ortho Clinical Diagnostics
Pencoe, UK

OCD Mechanical Info. – FOR INTERNAL USE ONLY

Designer Who Last Modified File:	<i>Candace Rechsteiner</i>	SPC Number in OTIS:	SPC54565	12-08-15 CR used 601-80-028-1CRMU to created 601-80-116-1 with revs per marked up PDF for Crimson PH2 12-09-15 KT signed.
Date File Was Last Modified:	12-08-15	Dimension on SPC:	2" x 7/8"	
2nd Designer review: (layout and requested changes only)	12-09-15 KT	Line Screen:	20% Black & 30% PMS 185 85 line screen	
PMS Colors Used in File:	Black		PMS 185	
			PMS 298	

601-80-116-1

Red Cells Vial Label



Sharon 12th Oct 2017


Ortho Clinical Diagnostics
Pencoed, UK

OCD Mechanical Info. – FOR INTERNAL USE ONLY

Designer Who Last Modified File:	Candace Rechsteiner	SPC Number in OTIS:	SPC54566	12-08-15 CR used 601-80-029-1CRMU to created 601-80-117-1 with revs per marked up PDF for Crimson PH2 12-09-15 KT signed.
Date File Was Last Modified:	12-08-15	Dimension on SPC:	2" x 7/8"	
2nd Designer review: (layout and requested changes only)	12-09-15 KT	Line Screen:	20% Black & 30% PMS 185 85 line screen	
PMS Colors Used in File:	Black	PMS 185	PMS 298	

601-80-117-1

Red Cells Vial Label

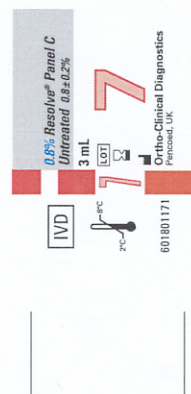

Ortho Clinical Diagnostics
Pencoed, UK

12th Oct 20

OCD Mechanical Info. – FOR INTERNAL USE ONLY


Designer Who Last Modified File:	Candace Rechsteiner	SPC Number in OTIS:	SPC54567	12-07-12 CR used 601-80-030-1CRMU to created 601-80-118-1 with revs per marked up PDF for Crinson PH2 12-09-15 KT signed. 12-10-15 CR moved slug down per PG for rendering. 12-11-15 KT signed.
Date File Was Last Modified:	12-08-15	Dimension on SPC:	2" x 7/8"	
2nd Designer review: (layout and requested changes only)	12-11-15 KT	Line Screen:	20% Black & 30% PMS 185 85 line screen	
PMS Colors Used in File:	Black	PMS 185	PMS 298	

601-80-118-1

Red Cells Vial Label

NOT FOR PRODUCTION USE


12th Oct 2017
Ortho Clinical Diagnostics
Pencoed, UK



OCD Mechanical Info. – FOR INTERNAL USE ONLY

Designer Who Last Modified File:	Candace Rechsteiner	SPC Number in OTIS:	SPC55568	12-08-15 CR used 601-80-031-1CRMU to create 601-80-119-1 with revs per marked up PDF for Crimson PH2. 12-16-15 CR made rev per KD review 12-17-15: KD signed.
Date File Was Last Modified:	12-16-15	Dimension on SPC:	2" x 7/8"	
2nd Designer review: (layout and requested changes only)	12-17-15	Line Screen:	20% Black & 30% PMS 185 85 line screen	
PMS Colors Used in File:	Black	PMS 185	PMS 298	

601-80-119-1 Red Cells Vial Label



Ortho Clinical Diagnostics
Pencoed, UK


12th Oct 2017


OCD Mechanical Info. – FOR INTERNAL USE ONLY

Designer Who Last Modified File:	Candace Rechsteiner	SPC Number in OTIS:	SPC54569	12-08-15 CR used 601-80-032-1 CRMU to create 601-80-120-1 with revs per marked up PDF for Crimson PH2. 12-15-15: KD signed.
Date File Was Last Modified:	12-08-15	Dimension on SPC:	2" x 7/8"	
2nd Designer review: (layout and requested changes only)	12-15-15:KD	Line Screen:	20% Black & 30% PMS 185 85 line screen	
PMS Colors Used in File:	Black		PMS 185	
			PMS 298	

601-80-120-1

Red Cells Vial Label




 Ortho Clinical Diagnostics
 Pencoed, UK
 2017

Designer Who Last Modified File:	Candace Rechsteiner	SPC Number in OTIS:	SPC54570
Date File Was Last Modified:	12-08-15	Dimension on SPC:	2" x 7 7/8"
2nd Designer review: (layout and requested changes only)	12-15-15:KD	Line Screen:	20% Black & 30% PMS 185 85 line screen
PMS Colors Used in File:	Black PMS 185 PMS 298		

12th Oct 2017

Ortho Clinical Diagnostics
Pencoed, UK

