


OCD Mechanical Info. - FOR INTERNAL USE ONLY

Designer/Who Last Modified File:	Cardiacs Rechsteiner	SPC Number in OTIS:	SPC56494	12-01-15 CH used 701-80-011-1 (CRM) to create 701-80-011-1 with rows per marked
Date File Was Last Modified:	12-02-15	Dimension on SPC:	4.39" x 3.12" x 7.14"	12-01-15 CH used 701-80-011-1 (CRM) to create 701-80-011-1 with rows per marked
2nd Designer review:	12-02-15 KT	Line Screen:	None	12-01-15 CH used 701-80-011-1 (CRM) to create 701-80-011-1 with rows per marked
PMS Colors Used in File:	Black	PMS 185	PMS 258	12-02-15 CH made rows per KT review.
			Non	
			Ventish	

701-80-011-1
Red Cells Carton
France

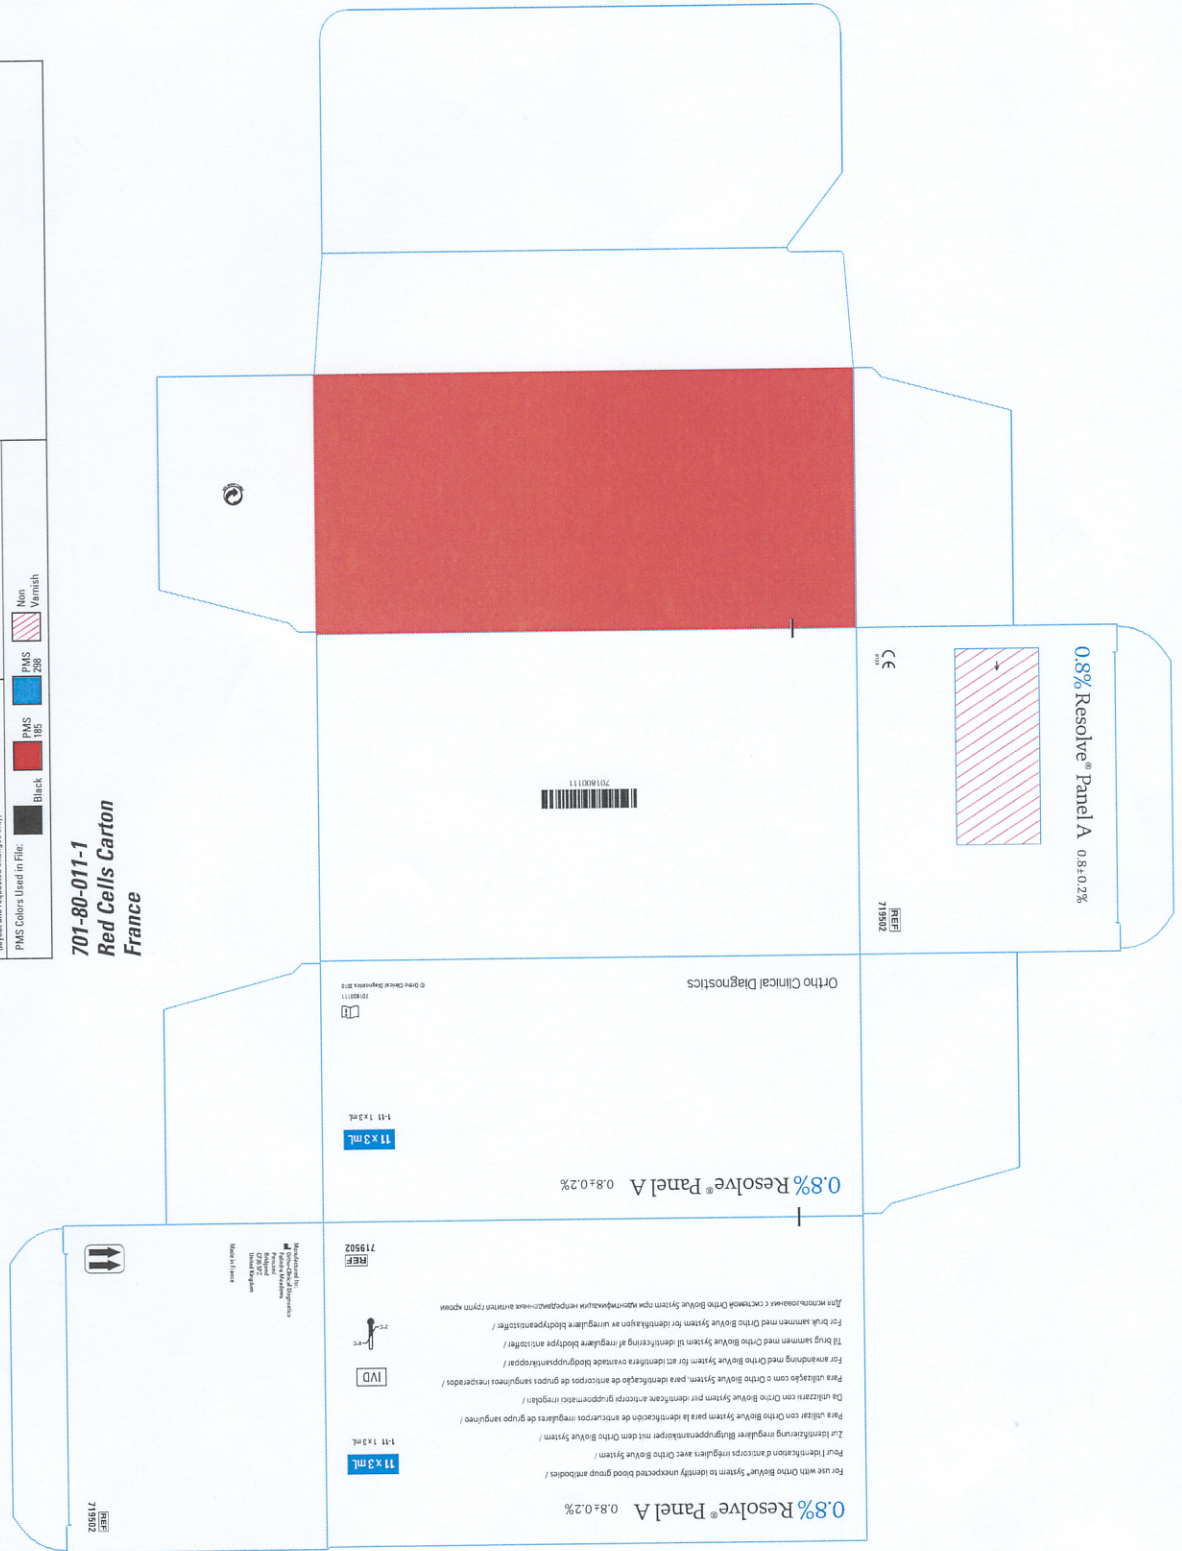


Ortho Clinical Diagnostics
Pencoe, UK

12th Oct 2017

OCD Mechanical Info. – FOR INTERNAL USE ONLY

Designer Who Last Modified File:	Candace Rechsteiner	SPC Number in OTIS:	SPC54577	11-30-15 CR used 616-80-000-1CRRMU to create document 616-80-044-1 with revs on marked up PDF from PG for Crimson PH2. 12-01-15 KT signed.
Date File Was Last Modified:	11-30-15	Dimension on SPC:	2" x 7/8"	
2nd Designer review: (layout and requested changes only)	12-01-15 KT	Line Screen:	30% PMS 298 / 85 line screen	
PMS Colors Used in File:	Black		PMS 185	
			PMS 298	

616-80-044-1
Red Cells Vial Label



Ortho Clinical Diagnostics
Pencoe, UK


12/01/15 12:00 PM

OCD Mechanical Info. – FOR INTERNAL USE ONLY

Designer Who Last Modified File:	Candace Rechsteiner	SPC Number in OTIS:	SPC54578	11-30-15 CR used 616-80-001-1CRMU to create document 616-80-045-1 with revs on marked up PDF from PG for Crimson PH2. 12-01-15 KT signed.
Date File Was Last Modified:	11-30-15	Dimension on SPC:	2" x 7/8"	
2nd Designer review: (layout and requested changes only)	12-01-15 KT	Line Screen:	30% PMS 298 / 85 line screen	
PMS Colors Used in File:	Black		PMS 185	
			PMS 298	

616-80-045-1

Red Cells Vial Label



Ortho Clinical Diagnostics
Pencoed, UK


12th Oct 2017

OCD Mechanical Info. – FOR INTERNAL USE ONLY

Designer Who Last Modified File:	Candace Rechsteiner	SPC Number in OTIS:	SPC54579	11-30-15 CR used 616-80-002-1 CRMU to create document 616-80-046-1 with revs on marked up PDF from PG for Crimson PH2. 12-01-15 KT signed.
Date File Was Last Modified:	11-30-15	Dimension on SPC:	2" x 7/8"	
2nd Designer review: (layout and requested changes only)	12-01-15 KT	Line Screen:	30% PMS 298 / 65 line screen	
PMS Colors Used in File:	Black		PMS 185	
			PMS 298	

616-80-046-1

Red Cells Vial Label



Ortho Clinical Diagnostics
Pencoed, UK


Handwritten signature 12th Oct 2017

OCD Mechanical Info. – FOR INTERNAL USE ONLY

Designer Who Last Modified File:	Candace Rechsteiner	SPC Number in OTIS:	SFC54580	11-30-15 CR used 616-80-003-1CRMU to create 615-80-047-1 with revs per marked up PDF from PG for Crimson PH2. 12-01-15 KT signed.
Date File Was Last Modified:	11-30-15	Dimension on SPC:	2" x 7/8"	
2nd Designer review: (layout and requested changes only)	12-01-15 KT	Line Screen:	30% PMS 298 / 85 line screen	
PMS Colors Used in File:	Black   			

616-80-047-1

Red Cells Vial Label



Ortho Clinical Diagnostics
Pencoed, UK

12th Oct 2017

OCD Mechanical Info. – FOR INTERNAL USE ONLY

Designer Who Last Modified File:	Candace Rechsteiner	SPC Number in OTIS:	SPC54581	11-30-15 CR used 616-80-004-1CRMU to create document 616-80-048-1 with revs on marked up PDF from PG for Crimson PH2. 12-01-15 KT signed.
Date File Was Last Modified:	11-30-15	Dimension on SPC:	2" x 7/8"	
2nd Designer review: (layout and requested changes only)	12-01-15 KT	Line Screen:	30% PMS 298 / 85 line screen	
PMS Colors Used in File:	Black	PMS 185	PMS 298	

616-80-048-1

Red Cells Vial Label




Ortho Clinical Diagnostics
Pencoed, UK

Handwritten signature 12th Oct 2017

OCD Mechanical Info. – FOR INTERNAL USE ONLY

Designer Who Last Modified File:	Candace Hechsteiner	SPC Number in OTIS:	SPC54582	11-30-15 CR used 616-80-005-1CRMU to create document 616-80-049-1 with revs on marked up PDF from PG for Crimson PH2. 12-01-15 KT signed.
Date File Was Last Modified:	11-30-15	Dimension on SPC:	2" x 7/8"	
2nd Designer review: (layout and requested changes only)	12-01-15 KT	Line Screen:	30% PMS 298 / 85 line screen	
PMS Colors Used in File:	Black	PMS 185	PMS 298	

616-80-049-1 Red Cells Vial Label



Ortho Clinical Diagnostics
Pencoed, UK


12th Oct 2017

OCD Mechanical Info. – FOR INTERNAL USE ONLY

Designer Who Last Modified File:	Candace Rechsteiner	SPC Number in OTIS:	SPC54583	11-30-15 CR used 616-80-006-1CRMU to create document 616-80-050-1 with revs on marked up PDF from PG for Crimson PH2. 12-01-15 KT signed.
Date File Was Last Modified:	11-30-15	Dimension on SPC:	2" x 7/8"	
2nd Designer review: (layout and requested changes only)	12-01-15 KT	Line Screen:	30% PMS 298 / 85 line screen	
PMS Colors Used in File:	Black  PMS 185  PMS 298 			

616-80-050-1

Red Cells Vial Label



Ortho Clinical Diagnostics
Pencoe, UK


Handwritten signature 12th Oct 2017

OCD Mechanical Info. – FOR INTERNAL USE ONLY

Designer Who Last Modified File:	Candace Rechsteiner	SPC Number in QTLIS:	SPC54584	11-30-15 CR used 616-80-007-1 CRMU to create document 616-80-051-1 with revs on marked up PDF from PG for Crimson PH2. 12-01-15 KT signed.
Date File Was Last Modified:	11-30-15	Dimension on SPC:	2" x 7/8"	
2nd Designer review: (layout and requested changes only)	12-01-15 KT	Line Screen:	30% PMS 298 / 85 line screen	
PMS Colors Used in File:	Black  PMS 185  PMS 298 			

616-80-051-1

Red Cells Vial Label




Ortho Clinical Diagnostics
Pencoed, UK

Handwritten signature 12th Oct 2017

OCD Mechanical Info. – FOR INTERNAL USE ONLY

Designer Who Last Modified File:	Candace Rechsteiner	SPC Number in OTIS:	SPC54585	11-30-15 CR used 616-80-008-1CRMU to create document 616-80-052-1 with revs on marked up PDF from PG for Crimson PH2. 12-01-15 KT signed.
Date File Was Last Modified:	11-30-15	Dimension on SPC:	2" x 7/8"	
2nd Designer review: (layout and requested changes only)	12-01-15 KT	Line Screen:	30% PMS 298 / 85 line screen	
PMS Colors Used in File:				
PMS 185 PMS 298 Black				

616-80-052-1
Red Cells Vial Label



Ortho Clinical Diagnostics
Pencoed, UK


12th Oct 2017

OCD Mechanical Info. – FOR INTERNAL USE ONLY

Designer Who Last Modified File:	Candace Rechsteiner	SPC Number in OTIS:	SPC54586	11-30-15 CR used 616-80-009-1CRMU to create document 616-80-053-1 with revs on marked up PDF from PG for Crimson PH2. 12-01-15 KT signed.
Date File Was Last Modified:	11-30-15	Dimension on SPC:	2" x 7/8"	
2nd Designer review: (layout and requested changes only)	12-01-15 KT	Line Screen:	30% PMS 298 / 85 line screen	
PMS Colors Used in File:	Black		PMS 185	
			PMS 298	

616-80-053-1

Red Cells Vial Label



Ortho Clinical Diagnostics
Pencoed, UK


Monahan 12th Oct 2017

OCD Mechanical Info. – FOR INTERNAL USE ONLY

Designer Who Last Modified File:	Candace Rechsteiner	SPC Number in OTIS:	SPC54587	12-02-15 CR used 616-80-010-1 to create document 616-80-054-1 with revs on marked up PDF from PG for Crimson PH2. 12-02-15 KT signed.
Date File Was Last Modified:	12-02-15	Dimension on SPC:	2" x 7/8"	
2nd Designer review: (layout and requested changes only)	12-02-15 KT	Line Screen:	30% PMS 298 / 85 line screen	
PMS Colors Used in File:	Black		PMS 185	
			PMS 298	

616-80-054-1

Red Cells Vial Label



Ortho Clinical Diagnostics
Pencoed, UK

12th Oct 2015